A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com



IMPORTANT

READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.

RAB fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

WARNINGS:


- Make certain power is OFF before installing or maintaining fixture. No user serviceable parts inside.
- To prevent wiring damage or abrasion, do not expose wiring to edges of sharp objects.

CAUTION: For proper weatherproof function, all gaskets must be seated properly and all screws inserted and tightened firmly. Suitable for wet locactions. Min. 90°C Supply Conductors.

NOT SUITABLE FOR UPLIGHTING WHEN INSTALLED IN WET AREAS.

SECURING MOUNTING WEDGE TO SQUARE POLE


- 1. Refer to the **POLE DRILLING DETAIL** to mark and drill mounting holes in the **Square Pole** as shown in Fig. 14.
- 2. Line up Bolster Plate, Mounting Gasket and Mounting Wedge (provided) with drilled holes on Pole as shown in Fig.1.
- Secure the Bolster Plate, Mounting Gasket and Mounting Wedge to Pole with (2) Nord Locking Washers (provided) and 3/8-16 Allen Head (2) Mounting Bolts (provided). Do NOT tighten Mounting Bolts all the way.
- **4.** Be sure that the **Mounting Gasket** and **Mounting Wedge** are seated properly.
- Feed supply wires from Square Pole through center of Mounting Gasket and Mounting Wedge.

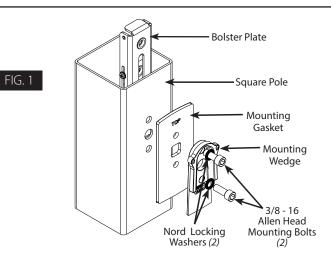

SECURING MOUNTING WEDGE TO ROUND POLE

- 1. Refer to the **POLE DRILLING DETAIL** to mark and drill mounting holes in the **Round Pole** as shown in Fig. 15.
- 2. Line up Bolster Plate, Pole Mounting Gasket, (RPA) Round Pole Adapter, Mounting Gasket and Mounting Wedge (provided) with drilled holes on Round Pole as shown in Fig. 2.
- 3. Secure the Bolster Plate, Pole Mounting Gasket, (RPA) Round Pole Adapter, Mounting Gasket and Mounting Wedge to Pole with (2) Nord Locking Washers (provided) and 3/8-16 Allen Head (2) Mounting Bolts (provided). Do NOT tighten Mounting Bolts all the way.
- 4. Be sure that the Pole Mounting Gasket, (RPA) Round Pole Adapter, Mounting Gasket and Mounting Wedge are seated properly.
- Feed supply wires from Round Pole through center of Mounting Wedge, Mounting Gasket, (RPA) Round Pole Adapter and Pole Mounting Gasket.



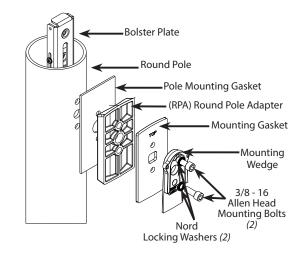

A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com

MOUNTING FIXTURE TO SQUARE/ROUND POLE

- 1. Slide the Fixture onto the Mounting Wedge as shown in Fig. 3.
- 2. Ensure that the Fixture is properly seated on the Mounting Wedge.
- **3.** Open **Arm Cover** by loosening (1) **Arm Cover Screw** and allow the **Arm Cover** to swing open (*Fig. 3*).
- **4.** Secure the Fixture to the **Mounting Wedge** by tightening (2) **Mounting Wedge Screws**.
- 5. Wire the Fixture leads to the supply wires using UL listed wire connectors according to NEC and local codes (*Fig. 16*).

To finish square pole or round pole mount follow instructions below:

SOUARE POLE MOUNT

- 1. Tighten Mounting Bolts (2) to fully compress the Mounting Gasket against the Square Pole and secure Fixture to Mounting Wedge (Fig. 1).
- 2. Replace the Arm Cover and secure with (1) Arm Cover Screw. Be sure not to pinch the wires (Fig. 3).


ROUND POLE MOUNT


- 1. Tighten Mounting Bolts (2) to fully compress the Pole Mounting Gasket, (RPA) Round Pole Adapter, Mounting Gasket and Mounting Wedge against the Round Pole and secure Fixture to Mounting Wedge (Fig. 2).
- 2. Replace Arm Cover and secure with (1) Arm Cover Screw. Be sure not to pinch the wires (Fig. 3).

SLIPFITTER MOUNTING

WARNING: RISK OF SERIOUS INJURY OR DEATH!
DO NOT MOUNT THE SLIPFITTER TO A TENON OR BRACKET
THAT IS MORE THAN 20 DEGREES FROM VERTICAL. MOUNTING
ANY ANGLE OTHER THAN 0-20° DEGREES INCREASES THE RISK
OF DISENGAGEMENT AND/OR FAILURE OF THE SLIPFITTER.
INSTALL THE POLE ON A SECURE BASE OR INSTALL THE
BRACKET TO A WALL FIRST, THEN PLACE LUMINAIRE ONTO
THE POLE OR BRACKET. DO NOT LIFT ASSEMBLED LUMINAIRE
AND POLE, OR LUMINAIRE AND BRACKET, LUMINAIRE OR
POLE/BRACKET MAY DISENGAGE.

- 1. The Slipfitter fits a 2 3/8" O.D. Tenon. Feed the supply wires from the Pole through the Slipfitter. Place the Slipfitter over the Tenon and secure with Set Screws (2) on the side of the Slipfitter (Fig. 4).
- 2. Attach the Mounting Gasket and Mounting Wedge to the Slipfitter with (2) Nord Locking Washers (provided) and 3/8-16 Allen Head (2) Mounting Bolts (provided). DO NOT tighten Mounting Bolts all the way (Fig. 5).

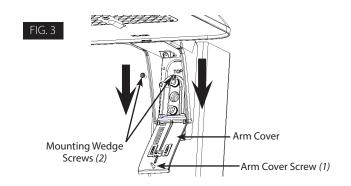

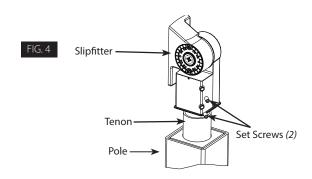





FIG. 6



A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION



Safety/Tether

Cable (Large/X-Large

Fixtures ONLY)

RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com


SLIPFITTER MOUNTING (cont'd)


- **3.** Be sure that the **Mounting Gasket** and **Mounting Wedge** are seated properly.
- **4.** Slide the **Fixture** onto the **Mounting Wedge** as shown in Fig. 3. Ensure that the fixture is properly seated on the **Mounting Wedge**.
- **5.** Open **Arm Cover** by loosening (1) **Arm Cover Screw** and allow the **Arm Cover** to swing open.
- **6.** Secure the Fixture to the **Mounting Wedge** by tightening (2) **Mounting Wedge Screws**.
- 7. Wire the Fixture leads to the supply wires using UL listed wire connectors according to NEC and local codes (Fig. 16).
- 8. Tighten Mounting Bolts (2) to compress the Mounting Gasket against the Slipfitter (Fig. 5).
- **9.** Replace **Arm Cover** and secure with (1) **Arm Cover Screw.** Be sure not to pinch the wires
- 10. To adjust the angle of the Slipfitter remove Screws (2) and the Slipfitter Cover Plate. Loosen the Locking Bolt and swivel Fixture to desired angle. The graduation on the Slipfitter Cover Plate can be used as guidelines to adjust the angle (Fig. 6).
- 11. Tighten the Locking Bolt. Replace Slipfitter Cover Plate.


 Tighten Screws (2) and close the Plug. Seal Plug using Teflon® tape or silicone sealant.
- **12.** For **Large** and **X-Large** fixtures a **Safety/Tether cable** is (*provided*) as shown in Fig. 7.

WALL MOUNTING

- 1. Refer to **Wall Mount Drilling Detail** to mark and drill mounting holes in the wall mounting surface as shown in Fig. 15.
- 2. Align **Wall Gasket** and **Wall Mounting Wedge** with the mounting holes. Insert the supply wires through **Wall Gasket** and **Wall Mounting Wedge** (Fig. 8).
- 3. Secure the **Wall Gasket** and **Wall Mounting Wedge** to the wall using suitable hardware *(by others)*.
- 4. Hang the **Wall Mounting Cover** on the fixture **Arm**. The **Wall Mounting Cover** is tapered to match the taper of the fixture mounting surface. (*Fig. 9*).
- 5. Open Arm Cover by loosening (1) Arm Cover Screw and allow the Arm Cover to swing open. Slide the Fixture onto the Wall Mounting Wedge as shown in Fig. 9. Ensure that the Fixture is properly seated on the Wall Mounting Wedge.
- 6. To secure the Fixture to the **Wall Mounting Wedge** compress the **Mounting Gasket** against the **Wall Mounting Wedge**, tightening (2) **Mounting Wedge Screws** (provided) as shown in Fig. 9.
- 7. Wire the Fixture leads to the supply wires using UL listed wire connectors according to NEC and local codes (Fig. 16).
- 8. Close **Arm Cover** and secure with (1) **Arm Cover Screw.** Be sure not to pinch the wires.
- 9. Snap the **Wall Mounting Cover** over the edges of the **Wall Mounting Wedge** for a clean finish.

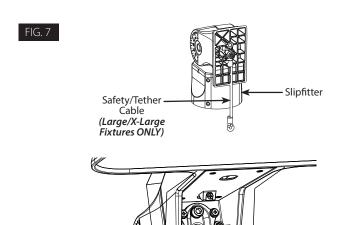

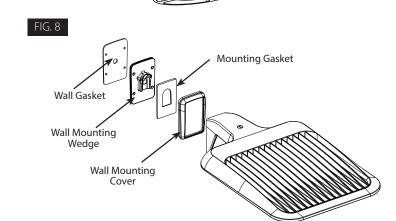

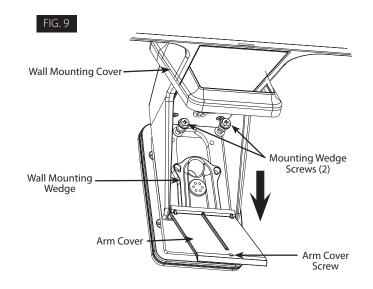

A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com

FIELD ADJUSTMENT

Photocell Operation:

This product is equipped with a photocell. Photocell factory setting is set to the "OFF" position. Should you wish to enable the Photocell "ON" feature slide the center switch to the "ON" position (Fig 12). If the Photocell is set to the "ON" position and it is daylight it may take up to 60-seconds for the light to turn off.

Color Temperature (CCT) Selection:

This product is equipped with 5000K, 4000K or 3000K CCT **Color Temperature** selection.

Power (%) Selection:

This product is equipped with 50%, 75% and 100% power output selection.

Follow instructions below to change **Photocell** operation, **Color Temperature** (*CCT*) and/or **Power** (%) from factory settings.

Factory Settings: 75% Power, 4000K CCT, Photocell/OFF

- 1. Locate the **Selector Switch Plug** on top of fixture housing as shown in Fig. 10 and remove plug.
- 2. Select Color Temperature (CCT), Power (%) and/or Photocell ON/OFF function by sliding the respective switch to the desired value (Fig. 11). Re-install Selector Switch Plug.





FIG. 11



MVS MODELS (External)

(optional remote sold separately for custom settings, CAT# MSR1).

Factory Settings:

• Brightness: 100%

Hold Time: 20 Minutes

Daylight: Disabled

Sensitivity: 100%

Stand-by dimming level: 20%

Stand-by time: 1 Minute

PIR MODELS (External)

(optional remote sold separately for custom settings, CAT# MSR1).

Factory Settings:

• Brightness: 100%

• Hold Time: 20 Minutes

• Daylight: Disabled

• Sensitivity: 100%


Stand-by dimming level: 20%


Stand-by time: 1 Minute

MVS / PIR INSTALLATION

- 1. Locate the **Sensor Connector Plug** on the underside of the fixture **Mounting Nec**k as shown in Fig. 12.
- 2. Unscrew the Sensor Connector Plug using a flat-bladed screwdriver
- 3. MVS or PIR sensor can now be threaded into position in place of the Sensor Connector Plug. Tighten MVS or PIR sensor by hand until snug, do not over-tighten.

FIG. 12





A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION




RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com

HOUSE-SIDE SHIELD ACCESSORY

House side shield accessory is sold separately Model #'s A34S-HSS, A34M-HSS, A34L-XL-HSS.


- Remove the Mounting Screws that attach the Lens Frame Assembly to the Fixture Heatsink as shown in Fig. 13. DO NOT DISCARD MOUNTING SCREWS.
- 2. Align the mounting holes of the **House-Side Shield** with the Lens and press the **House-Side Shield** against the Lens.
- 3. Thread all **Mounting Screws** back into the **Fixture Heatsink** to mechanically hold the **House-Side Shield** in place.





POLE DRILLING DETAIL


Dimensions of the holes on **PA** and **Bolster Plate.** This template is not to scale. Please use measurements as shown in Fig. 14.

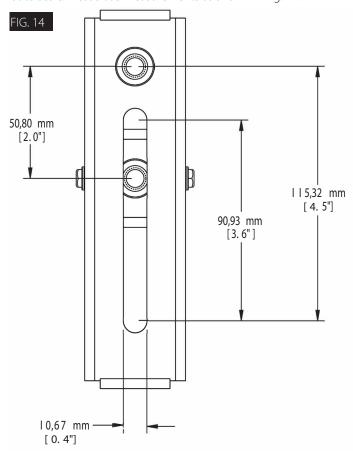

WALL MOUNT DRILLING DETAIL

Mounting hole dimensions for **Wall Mounting Plate**. This template is not to scale. Please use measurements as shown in Fig. 15.

FIG. 15

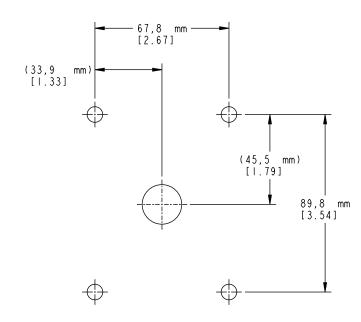

A34™ FIELD-ADJUSTABLE AREA LIGHT INSTALLATION



RAB Lighting is committed to creating high-quality, affordable, well-designed and energy-efficient LED lighting and controls that make it easy for electricians to install and end users to save energy. We'd love to hear your comments. Please call the Marketing Department at 888-RAB-1000 or email: marketing@rablighting.com

0-10V DIMMABLE WIRING

Universal voltage driver permits operation at 120V through 277V, 50 or 60 Hz. For 0-10V dimming, follow the wiring directions as shown in Fig. 16.

- 1. Connect the black fixture lead to the LINE supply lead.
- 2. Connect the white fixture lead to the COMMON supply lead.
- 3. Connect the GROUND wire from fixture to supply ground.
- 4. Connect the purple fixture lead to the (V+) DIM lead.
- 5. Connect the pink fixture lead to the (V-) DIM lead.

NOTE: Do not connect DIM V+ (purple)/ DIM V- (pink) to line voltage or supply ground.

LINE BLACK COMMON WHITE (+) DIMV PURPLE LIGHT (-) DIMV PINK Vaux 12V YELLOW GROUND GROUND

CLEANING & MAINTENANCE

CAUTION: Be sure fixture temperature is cool enough to touch. Do not clean or maintain while fixture is energized.

- 1. Clean lens with non-abrasive glass cleaning solution.
- 2. Do not open the fixture to clean the LED. Do not touch the LED.

TROUBLESHOOTING

- 1. Check that the line voltage at the fixture is correct. Refer to wiring directions.
- 2. Is the fixture grounded properly?
- 3. Is the photocell, if used, functioning properly?

Note: These instructions do not cover all details or variations in equipment nor do they provide for every possible situation during installation, operation or maintenance.

A34 - IN - 0324 P-100113